


Thomas & Betts

EMT CONNECTOR (RAINTIGHT)

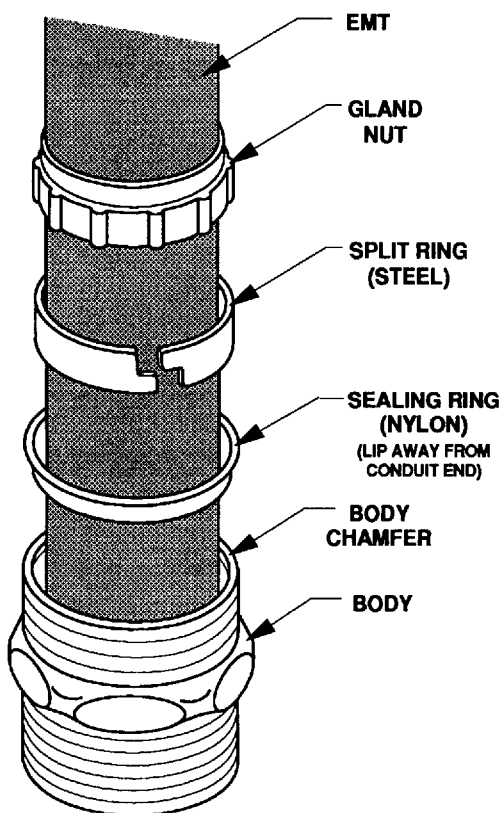

INSTALLING INSTRUCTIONS

1. Cut EMT and deburr cut end.
2. Slide gland nut, split ring (steel) and sealing ring (nylon) over EMT. See illustration. Note orientation of nylon sealing ring.
3. Install body over the end of EMT. Seat the sealing ring firmly into the body chamfer. Slide split ring against top of sealing ring. Hand tighten gland nut; torque to UL specs as shown below.

CAT. NO.	SIZE	UL TORQUE
5420	1-1/4"	1000 lb/in
5421	1-1/4"	1000 lb/in
5423	1-1/4"	1000 lb/in
4230	1/2"-90°	300 lb/in
4240	1/2"-90°	300 lb/in

WARRANTY: Thomas & Betts sells this product with the understanding that the user will perform all necessary test to determine the suitability of the product for his intended use. Thomas & Betts manufactures its goods and tools in a manner to be free of defects. Should any defect occur in its goods (within two years) or tools (within ninety days), Thomas & Betts, upon prompt notification, will at its option, exchange or repair the goods or tools or refund the purchase price.

Limitations and Exclusions: THIS WARRANTY IS IN LIEU OF ALL OTHER REPRESENTATIONS AND EXPRESSED AND IMPLIED WARRANTIES (INCLUDING THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR USE) AND UNDER NO CIRCUMSTANCES SHALL THOMAS & BETTS BE LIABLE FOR ANY INCIDENTAL OR CONSEQUENTIAL PROPERTY DAMAGES OR LOSSES.

Thomas & Betts
Electrical Division

1555 Lynnfield Road, Memphis, Tennessee 38119

Printed in U.S.A.

Made in U.S.A.

TA01145 A