


PORCELAIN AND PLASTIC LAMP HOLDERS

- UL Listed. File Number: E236781.
- Nickel-plated brass screw shell will not corrode.
- For Commercial, Industrial, Residential and Agricultural Lighting Applications.
- Medium-Base fits 3.25 inch or 4.0 inch outlet box.
- UV resistant Lamp Holders will not fade or discolor.
- Optional Plastic and Metal Safety Cages fit all Lamp Holders.
- Includes corrosion resistant mounting screws.
- Meets the requirements of the 2014 National Electrical Code:
 - Part Numbers: 16500, 16502, 16510, 16512 and 16514 - Articles 410.74(A)(B) and 410.122
 - Part Numbers: 16520, 16522, 16524 and 16526 - Articles 410.52, 410.74(A)(B) and 410.122

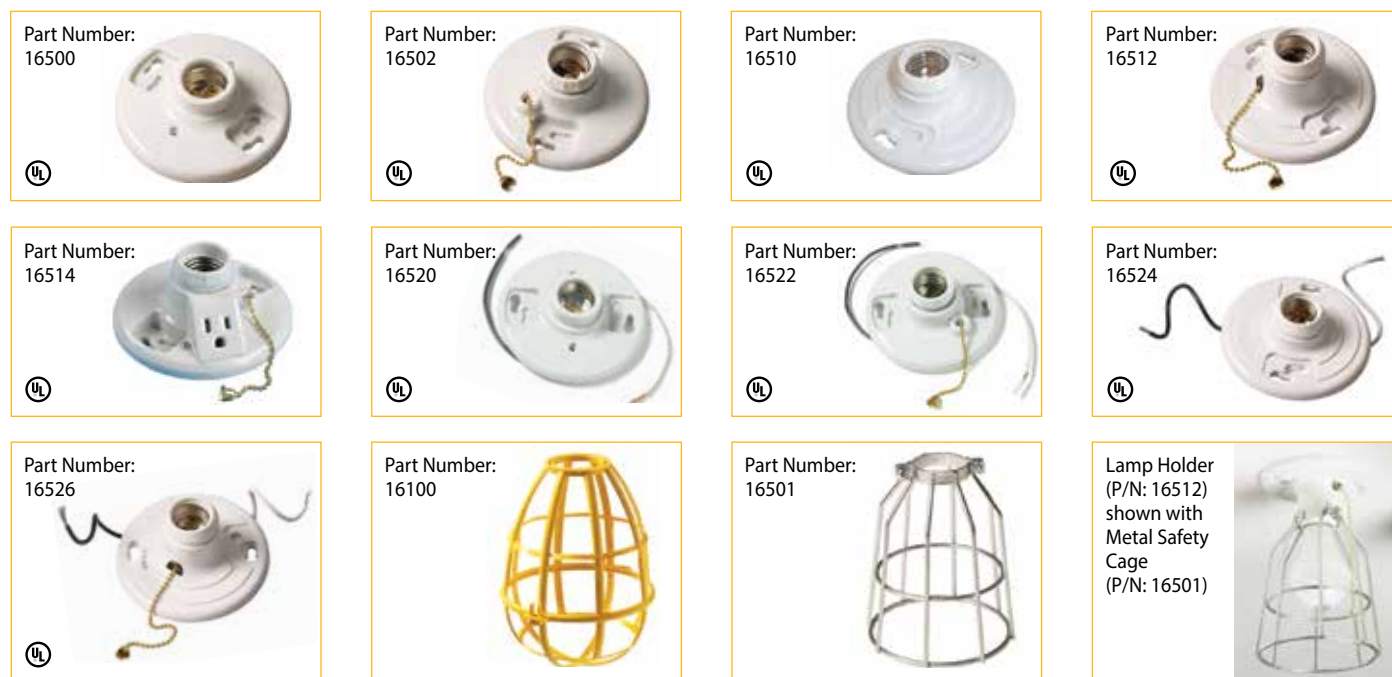

Catalog Number	UPC Number	Description	Order Unit	Unit Qty	Unit Pkg	Units/Case	TL Case Qty	Min Order Qty	MM Req	Ship Wt (Lbs)
16500	16500	Porcelain Lamp Holder: Keyless, 4-Terminal	EA	1	BX	48	48	48	Yes	33
16502	16502	Porcelain Lamp Holder: Pull Chain	EA	1	BX	48	48	48	Yes	35
16510	16510	Plastic Lamp Holder: Keyless, 4-Terminal	EA	1	BX	48	48	48	Yes	11
16512	16512	Plastic Lamp Holder: Pull Chain	EA	1	BX	48	48	48	Yes	13
16514	16514	Porcelain Lamp Holder: Pull Chain and 15 AMP Receptacle	EA	1	BX	48	48	48	Yes	40
16520	16520	Porcelain Lamp Holder: Keyless, 4-Terminal with 7" Black and White Conductors	EA	1	BX	48	48	48	Yes	33
16522	16522	Porcelain Lamp Holder: Pull Chain with 7" Black and White Conductors	EA	1	BX	48	48	48	Yes	35
16524	16524	Plastic Lamp Holder: Keyless, 4-Terminal with 7" Black and White Conductors	EA	1	BX	48	48	48	Yes	11
16526	16526	Plastic Lamp Holder: Pull Chain with 7" Black and White Conductors	EA	1	BX	48	48	48	Yes	13
16100	16100	Safety Cage: Yellow	EA	1	BX	10	10	10	Yes	1
16501	16501	Safety Cage: Metal	EA	1	BX	12	12	12	Yes	6

Note: Lamp Holders are sold ONLY in case quantities of 48 per Carton.

For Poultry Applications please review the information on Page 80.

UNITS OF MEASURE KEY Order Unit: The Unit to be ordered; Unit Qty: Number of pieces in each Unit; Unit Pkg: Unit Packages contained in the case - Packaging types - BG (Bag), BRL (Barrel), BX (Box), BN (Bulk), PKG (Package), EA (Each), RL (Roll), LB (Pound), C (Hundred), M (Thousand); Units/Case: Unit packages contained in the Case; TL Case Qty: The total number of items in each Master Case; Min Order Qty: The smallest Unit that can be ordered; MM Req: Must order multiples of the Unit in the stated quantities; Ship Wt (Lbs): Total weight of the units per Carton

PRODUCT WARRANTY

GENERAL PRODUCT WARRANTY

Engineered Products Company warrants that the products described herein, will be furnished free from defects in material and workmanship for 1 year. Any exceptions to this Warranty Statement will be detailed within the respective product section in this catalog, noted on the product, or the product packaging.

Engineered Products Company sole obligation for any breach of warranty under the terms herein shall be, at our option, to repair or provide replacement for the Product to which such warranty is breached, or to return all payments made with respect to such Product. Any Product(s) that are deemed to be defective must be specified by the Purchaser in a written notice to Engineered Products Company's Warranty Department within 1 year after receipt of such goods. Under no circumstances will Engineered Products Company be liable for loss of profits or incidental, indirect, consequential or special damages of any kind beyond the replacement cost of the defective merchandise.

Engineered Products Company shall not be liable for any losses arising from governmental action, an act of God, or the result of war, riot, strikes, civil commotion, sovereign conduct, or the act or conduct of any person or persons not party to or associated with Engineered Products Company.

For Poultry Farming Applications (continued on page 29)

EPCO recommends using Porcelain Lamp Holder(s) only for poultry farming applications. The lamp holder must be installed in a manner that will not permit dust or moisture to enter the junction box. In addition, the porcelain lamp holder must be mounted vertically with the lamp positioned below the lamp holder on a water-tight, dust-tight non-metallic junction box with an effective gasket between the junction box and the lamp holder as shown.

Use the following part numbers to facilitate and complete the installation as shown:



Porcelain Lamp Holder (P/N 16500),
Cork Gasket, and Junction Box (P/N 15246)

Catalog Number	UPC Number	Description	Order Unit	Unit Qty	Unit Pkg	Units/ Case	TL Case Qty	Min Order Qty	MM Req	Ship Wt (Lbs)
E05-003-000	N/A	Cork Gasket	EA	1	BG	12	12	12	Yes	1
15045	15045	12 Cubic Inch Junction Box: 1/2" and 3/4" Knockout Combo	EA	1	BX	12	12	12	Yes	6
15046	15046	12 Cubic Inch Junction Box: 1/2" Knockouts	EA	1	BX	12	12	12	Yes	6
15047	15047	12 Cubic Inch Junction Box: 3/4" Knockouts	EA	1	BX	12	12	12	Yes	6
15049	15049	19 Cubic Inch Junction Box: 3/4" Knockouts	EA	1	BX	12	12	12	Yes	6
15246	15246	12 Cubic Inch SPIDERBOX Junction Box: 1/2" Knockouts	EA	1	BX	12	12	12	Yes	6
15247	15247	12 Cubic Inch SPIDERBOX Junction Box: 3/4" Knockouts	EA	1	BX	12	12	12	Yes	6
16500	16500	Porcelain Lamp Holder: Keyless, 4-Terminal	EA	1	BX	48	48	48	Yes	33
16502	16502	Porcelain Lamp Holder: Pull Chain	EA	1	BX	48	48	48	Yes	35
16514	16514	Porcelain Lamp Holder: Pull Chain and 15 AMP Receptacle	EA	1	BX	48	48	48	Yes	40

- Note:** 1. Junction boxes include screws to affix the lamp holder to the junction box.
2. Plastic Lamp Holders are NOT suitable for this application!

WARNING: EPCO Lamp Holders Must Be Installed in Accordance with the following National Electric Code Articles that state:

"Where the wiring method is conduit, tubing, Type AC cable, or other cables, a box or conduit body shall be installed at each conductor splice point, outlet point, switch point, junction point, termination point, or pull point, unless otherwise permitted in NEC 300.15(A) through (L).

In addition, Article 502.130(2)(3) requires luminaires for fixed lighting shall be provided with enclosures that are dust tight or otherwise identified for the location as well as protected from physical damage by suitable guards for areas described in Article 547.1(A).

If the Contractor has taken care to install the porcelain lamp holder(s) in the proper manner as described and shown above and believes the lamp holder is defective, and wants to file a warranty claim, EPCO will require an "Affidavit of Inspection" from the Contractors local Electrical Inspector to validate the defined installation procedure. This document is intended to protect the integrity of the company (EPCO) and the Distributor.