


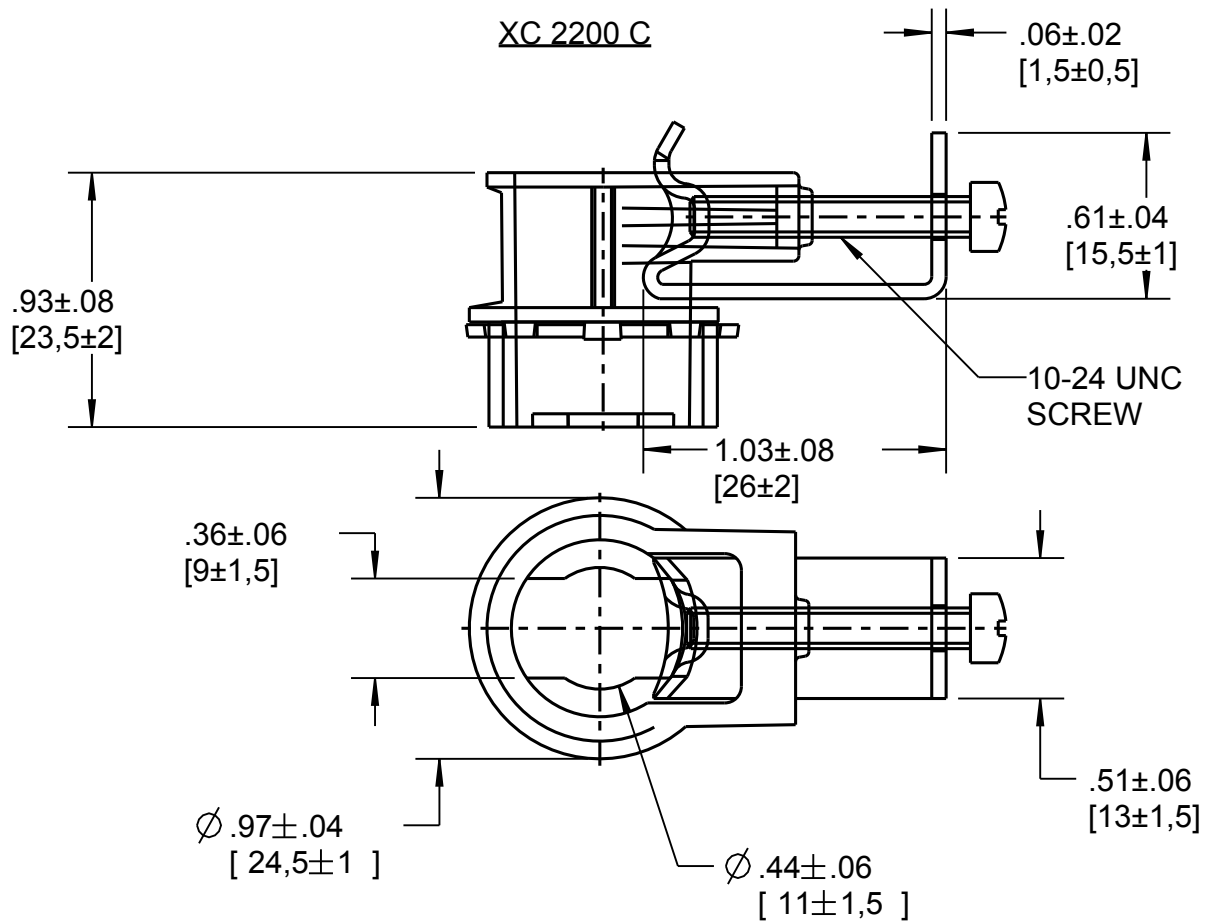

NOTES:

1. FOR DRY LOCATIONS
2. INSTALLATION TORQUE 15 Lb.In
3. FOR AC ALUM. (.464-.622")/ 14-2, 14-4, 12-2, 10-4
4. FOR AC STEEL (.457-.539")/ 14-2, 14-4, 12-4
5. FOR MCI ALUM. (.433-.630")/ 14-2, 12-2, 12-3, 12-4, 10-2, 10-3
6. FOR MCI-A STEEL (.453-.579")/ 14-2, 14-4, 10-2, 10-3, 10-4
7. FOR NM SHEATHED CABLE 12-3,14-2, WITH GROUND (ONE)
8. FOR NM SHEATHED CABLE 12-2 WITHOUT GROUND (ONE)
9. FOR SE CABLE 8-3 (ONE)
10. ARMORED CABLE BUSHING REQUIRED FOR FLEXIBLE METAL CONDUIT

GENERAL NOTES		Thomas & Betts A Member of the ABB Group www.tnb.com			
1. ALL DIMENSIONS ARE FOR REFERENCE ONLY. 2. DIMENSIONS IN BRACKETS [] ARE IN METRIC UNITS.					
REVISIONS		DESCRIPTION: SADDLE CONNECTOR ASSEMBLY 3/8" BX/FLEX CONNECTOR			
**	SEE ERN (****) FOR APPROVAL SIGNATURES & RELEASE DATE. PROJECT NO: ****	ORIGINAL PROJECT NO / (ERN NO) 010M001161 / (2017684)	SHEET NO: 1 OF 1	REV. NO: 0	DRAWING NO: WSD-001761