

SEE TABLE

REPAIRABLE ☐

NON-REPAIRABLE ☐

B

M-8576

3



M-8576 3

NOTE:

1. CONCRETE COVER NOT SHOWN IN VIEWS FOR CLARITY.
2. DIM'S. INCHES [MM].
3. FLOOR BOX ADJUSTMENT: 1 1/4" BEFORE POUR
1/2" AFTER POUR.

LIST OF PARTS

DESCRIPTION	MATERIAL	FINISH
BOX	STEEL .0625 THK	PRE-GALV.
ADJUSTING BASE	STEEL .0625 THK	PRE-GALV.
ADJUSTING COLLAR	STEEL .0625 THK	PRE-GALV.
BOX DIVIDER	STEEL .0625 THK	PRE-GALV.
COVERFRAME ASM	SEE TABLE	
LEVELING SCREW	STEEL	ZINC PL.
FL.HD. ADJ. SCREW	STEEL	ZINC PL.
RD.HD. MTG. SCREW	STEEL	ZINC PL.
FL.HD. MTG. SCREW	STEEL	ZINC PL.
GROUND SCREW & WIRE	12 AWG CU	INSULATED
CONCRETE COVER	.010 TINPLATE	

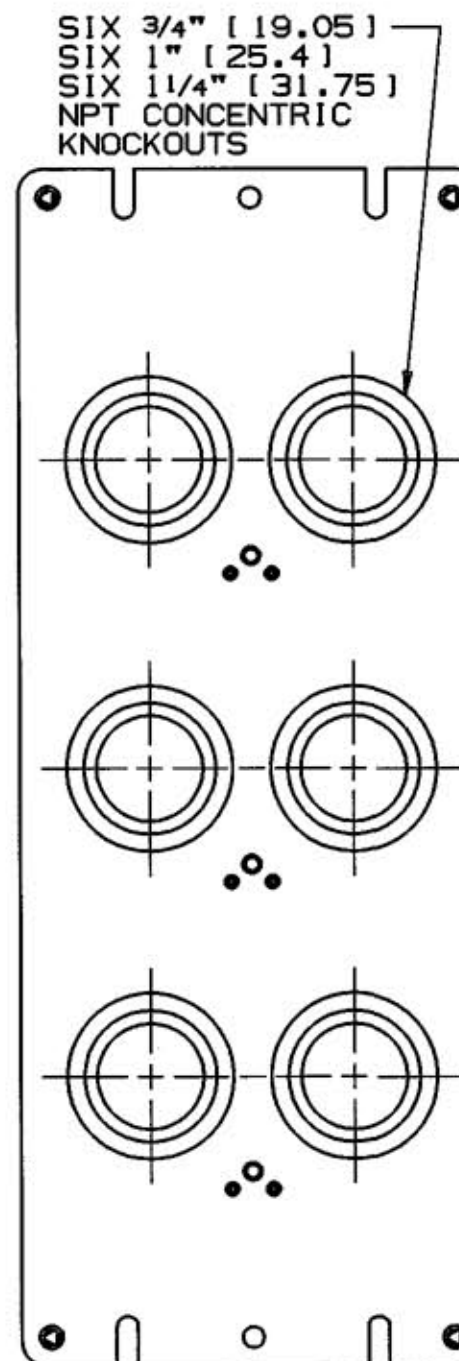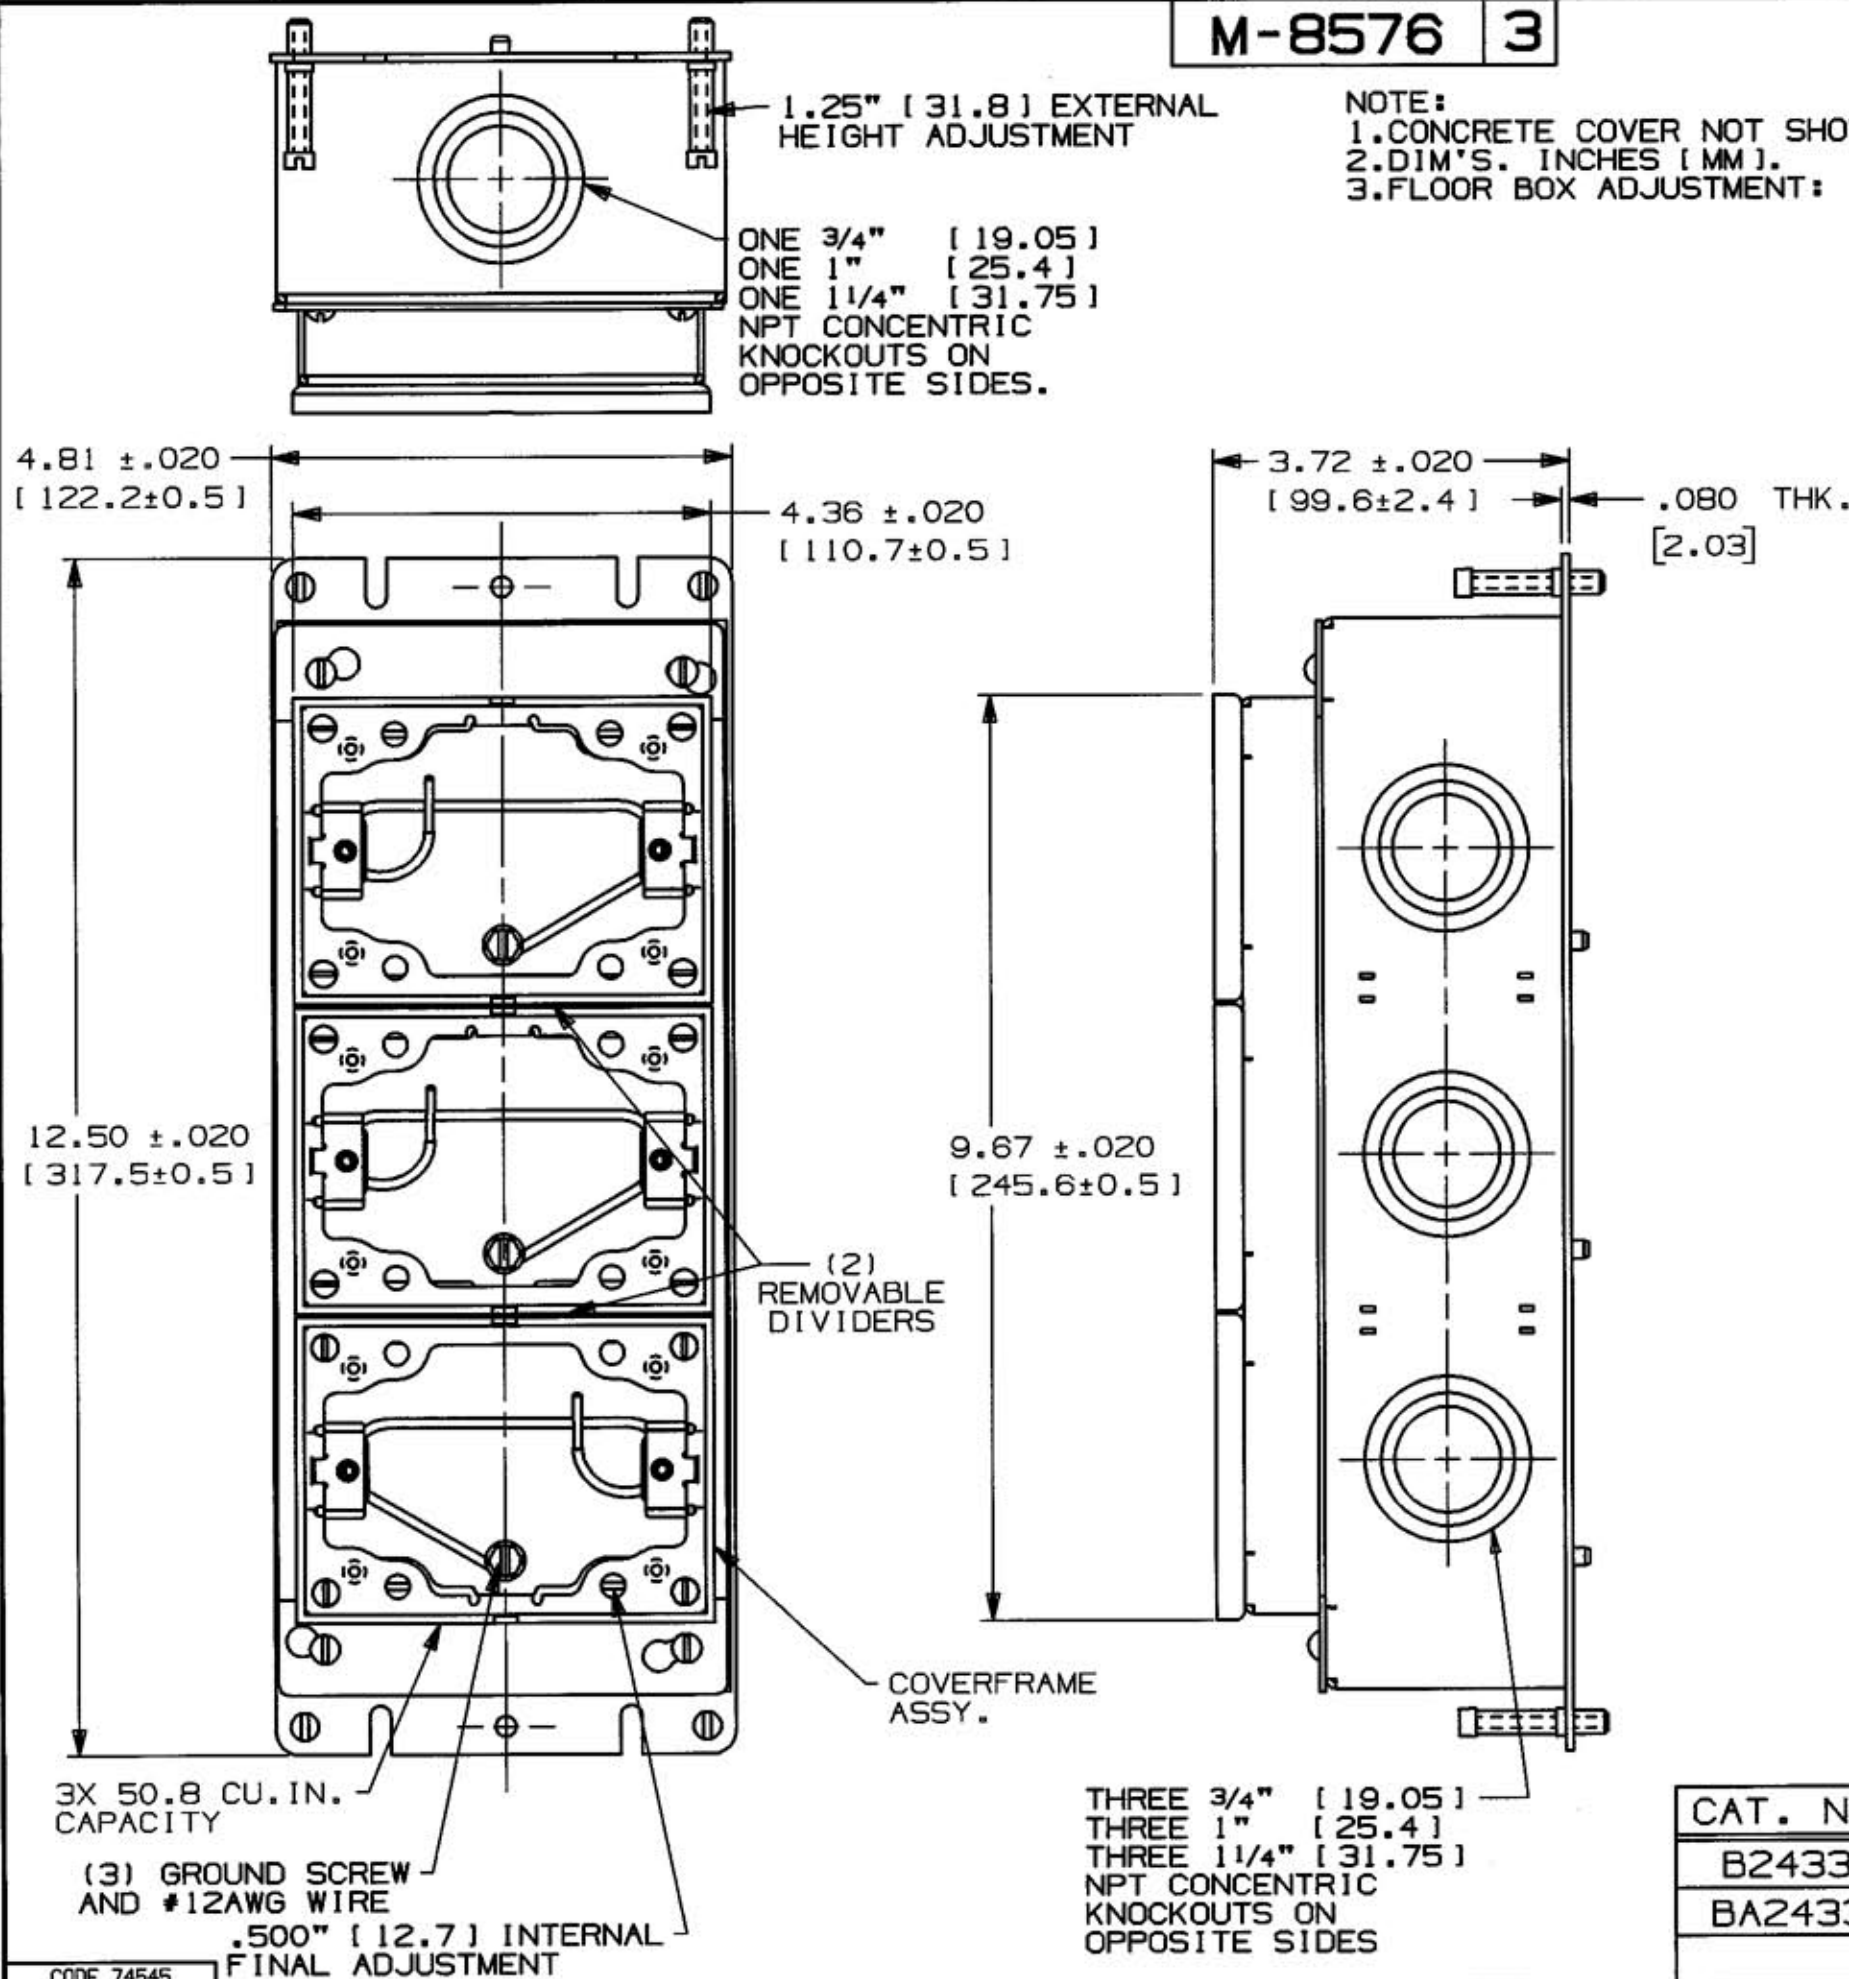

3	DIM 3.72 WAS 3.92 DCN#9375 PAC	TLS	3-26-02
2	CHANGE ALL KO'S TO FRACTIONS, ADD BACK VIEW, ADD NOTE 3. DCN 9086 GK/TS		11/19/01
1	INITIAL RELEASE #8865	TLS	8-9-01
SYM	REVISIONS	APP	DATE

THE DESIGN AND DIMENSIONS OF THE PRODUCT SHOWN ON THIS DRAWING ARE SUBJECT TO CHANGE WITHOUT NOTICE

TITLE
3 GANG DEEP
STAMPED STEEL
CONC. FLOOR BOX

CAT. NO.	COVERFRAME ASSY.
B2433	BRASS
BA2433	ALUMINUM

TOLERANCES UNLESS OTHERWISE SPECIFIED	WIRING DEVICE-KELLEMS HUBBELL INCORPORATED BRIDGEPORT, CT
FRACTIONS ± 1/64	DR. BY PAC APP. BY TLS
DECIMALS ± .005	TR. BY
ANGLES ± 2°	SCALE HALF
	CHK'D BY TLS DATE 8-9-01